





Hazardous (Classified) Location  
 Class I / Division 1 / Groups ABCD  
 Class I / Zone 0 / Ex ia IIC  
 Class I / Division 2 / Groups ABCD

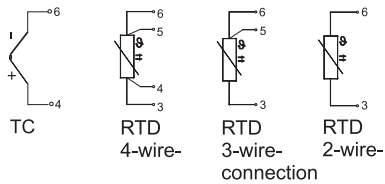

Nonhazardous Locations

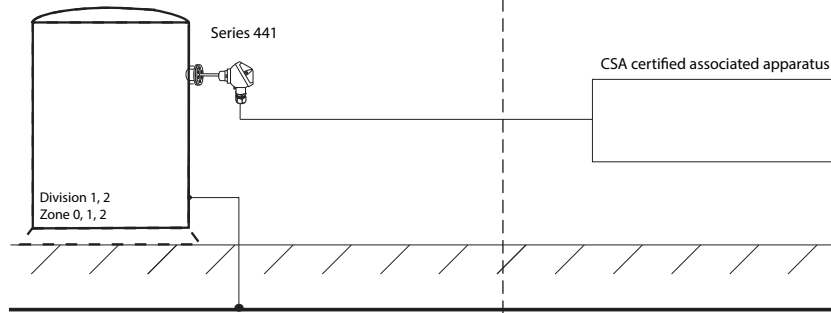

**Temperature range**

T4 -40 °C ... +85 °C  
 T5 -40 °C ... +70 °C  
 T6 -40 °C ... +55 °C

**INTRINSICALLY SAFE**

**Class I / Div. 1 / Groups ABCD**  
**Class I / Zone 0 / Ex ia IIC**

**NONINCENDIVE, FIELD WIRING**

**Class I / Div. 2 / Groups ABCD**

Sensor output circuits (Terminals 3...6)

$U_o$  or  $V_{oc}$  or  $V_t = 8.2 V$        $I_o$  or  $I_{sc} = 4.6 mA$        $P_o = 9.35 mW$

Group A, B resp. IIC       $C_o$  or  $C_a = 974 nF$        $L_o$  or  $L_a = 4.5 mH$   
 Group C, D resp. IIB, IIA       $C_o$  or  $C_a = 1900 nF$        $L_o$  or  $L_a = 8.5 mH$

**Installation Notes Series 441**



- CSA certified Apparatus must be installed in accordance with manufacturer's instructions.
- The installation must be in accordance with the Canadian Electrical Code.
- Use supply wires suitable for 5 °C above surroundings.
- Shall be installed in compliance with the enclosure, mounting, spacing and segregation requirements of the ultimate application.
- The configuration of the Series 441 transmitter is only permitted in nonhazardous locations.
- The voltage of the "tools" used for configuration should not exceed  $U_m = 30 V$ . This can be achieved e.g. by a battery powered laptop. An approved adapter with barrier has to be used for configuration using a PC with mains connection ( $U_m < 253 V$ ).
- Terminals 3 to 6 provide Intrinsically Safe and Nonincendive circuits to RTD, Thermocouples and other passive resistive devices.
- Only simple apparatus should be terminated to the sensor connection.  
 Simple apparatus are components as defined by the CEC (1.2 V, 0.1 A, 0.25 mW or 20  $\mu J$ ).
- Warning: Substitution of components may impair intrinsic safety or suitability for Class I, Division 2.

**INTRINSICALLY SAFE**

**Class I / Div. 1 / Groups ABCD**

- CSA certified Associated Apparatus must meet the following parameters:

$U_o \leq U_i$        $I_o \leq I_i$        $P_o \leq P_i$        $C_a \geq C_i + C_{cable}$        $L_a \geq L_i + L_{cable}$

Transmitter entity parameters are as follows:  
 $U_i$  or  $V_{max} \leq 30 V$  dc       $C_i = 0$   
 $I_i$  or  $I_{max} \leq 100 mA$        $L_i = 0$   
 $P_i \leq 750 W$


**NONINCENDIVE**

**Class I / Div. 2 / Groups ABCD**

- Intrinsic safety barrier not required.  $V_{max} \leq 35 V$  dc.
- Warning: Do not disconnect equipment unless power has been switched off or the area is known to be nonhazardous.
- Nonincendive field wiring installation  
 The Nonincendive Field Wiring Circuit Concept allows interconnection of Nonincendive Field Wiring Apparatus with Associated Nonincendive Field Wiring Apparatus or Associated Intrinsically Safe Apparatus or Associated Apparatus not specifically examined in combination as a system using any of the wiring methods permitted for unclassified locations, when  $V_{oc} \leq V_{max}$ ,  $C_a \geq C_i + C_{cable}$ ,  $L_a \geq L_i + L_{cable}$ .  
 Transmitter Nonincendive Field Wiring parameters are as follows:  
 $U_i$  or  $V_{max} \leq 30 V$  dc       $C_i = 0$        $L_i = 0$   
 $I_i$  or  $I_{max} =$  see following note below  
 For these current controlled circuits, the parameter  $I_{max}$  is not required and need not to be aligned with parameter  $I_{sc}$  and  $I_t$  of the Associated Nonincendive Field Wiring Apparatus or Associated Apparatus.

**Functional ratings**

These ratings do not supersede Hazardous Location values  
 $U_{nom} \leq 35$  dc       $I_{nom} \leq (4 \text{ to } 20) mA$

TITLE: <b>Series 441 CSA Control Drawing IS, NI</b>		PART NUMBER:		DATE: <b>11/05/2012</b>	
This document is PROPRIETARY to Pyromation, Inc.		SIZE: <b>A</b>	DRAWING NO: <b>M007301</b>	REV: <b>C</b>	SCALE: <b>N/A</b>
				 FORT WAYNE, INDIANA      (260) 484-2580	